

This information provided by:



Gross Automation
www.grossautomation.com


Call Toll Free:
800-349-5827

FIBERGLASS WALL THICKNESS	LETTER DESIGNATION	O.D. IN (mm)
STANDARD	S	Ø 4.14 (105 mm)
HEAVY	H	Ø 4.18 (106 mm)
BULLET RESISTANT	B	Ø 4.25 (108 mm)

CATALOG NUMBER

M EC


- 3 = 3 WAY INNER DUCT
- 4 = 4 WAY INNER DUCT
- S = STD WALL FIBERGLASS
- H = HEAVY WALL FIBERGLASS
- B = BULLET RES FIBERGLASS

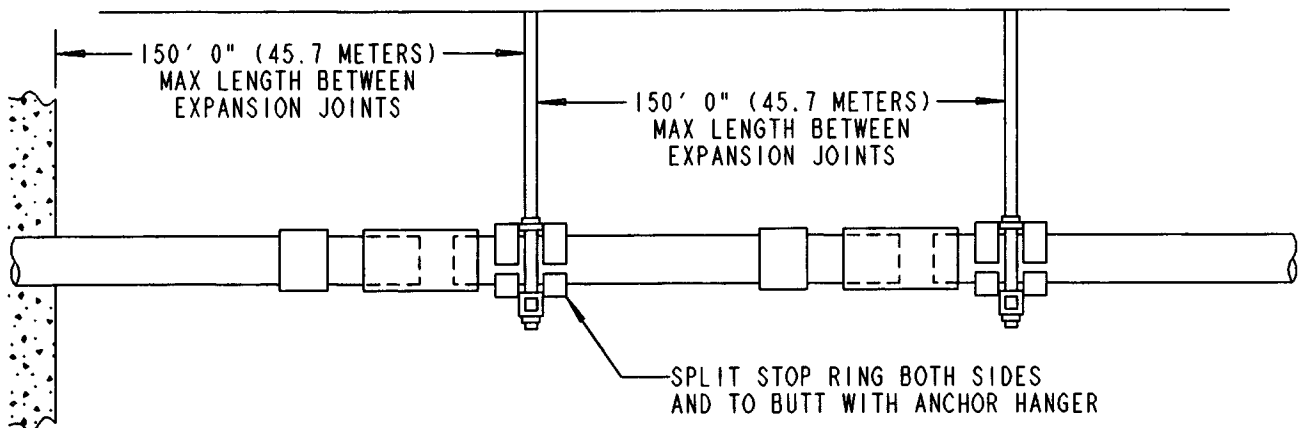

MALE END HOUSES FOUR (4) INNERDUCTS (4-WAY) OR THREE (3) INNERDUCTS (3-WAY) WHICH ARE FLUSH TO THE END OF THE PIPE

NOTE:
EXPANSION JOINT COMES ASSEMBLED WITH A 3" WIDE SPLIT, STOP RING THAT PRE-POSITIONS THE ASSEMBLY AT THE MID-POINT OF THE 6" STROKE AND MUST BE REMOVED AFTER INSTALLATION

FEMALE END HOUSES COUPLING BODY WHICH IS FIXED AND FLUSH TO THE END OF THE PIPE

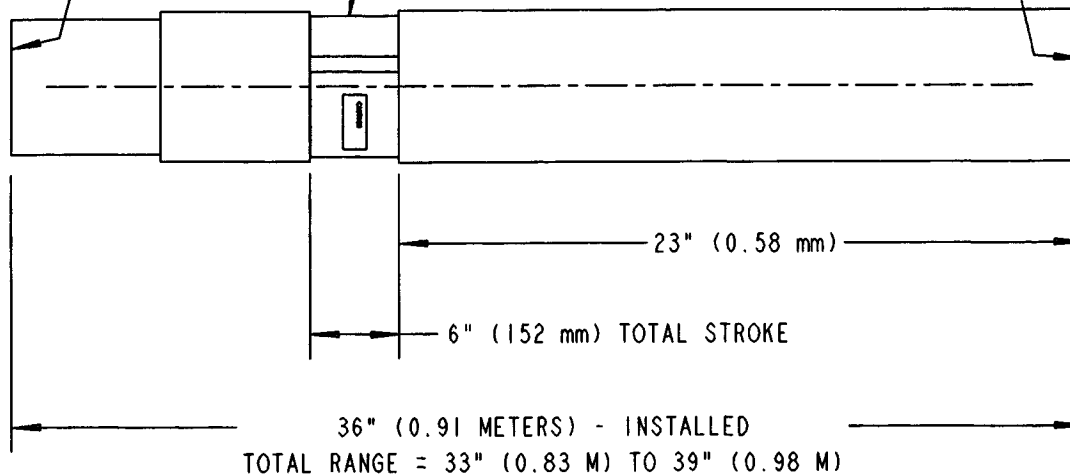

TITLE FIBERGLASS EXPANSION JOINT		DRN TCAT	DATE 10-6-92	PART NO: SEE CHART
LAMSON & SESSIONS	ALL DRAWINGS ARE THE PROPERTY OF LAMSON & SESSIONS AND SHALL NOT BE REPRODUCED IN ANY FORM WITHOUT LAMSON & SESSIONS' APPROVAL AND ARE TO BE PROMPTLY RETURNED UPON REQUEST.	APP <i>[Signature]</i>	DATE 5/22/93	DRAWING NO: AC01178
		REV. B		